





DIN EN ISO 17892-4

Anlage	3.1
---------------	------------

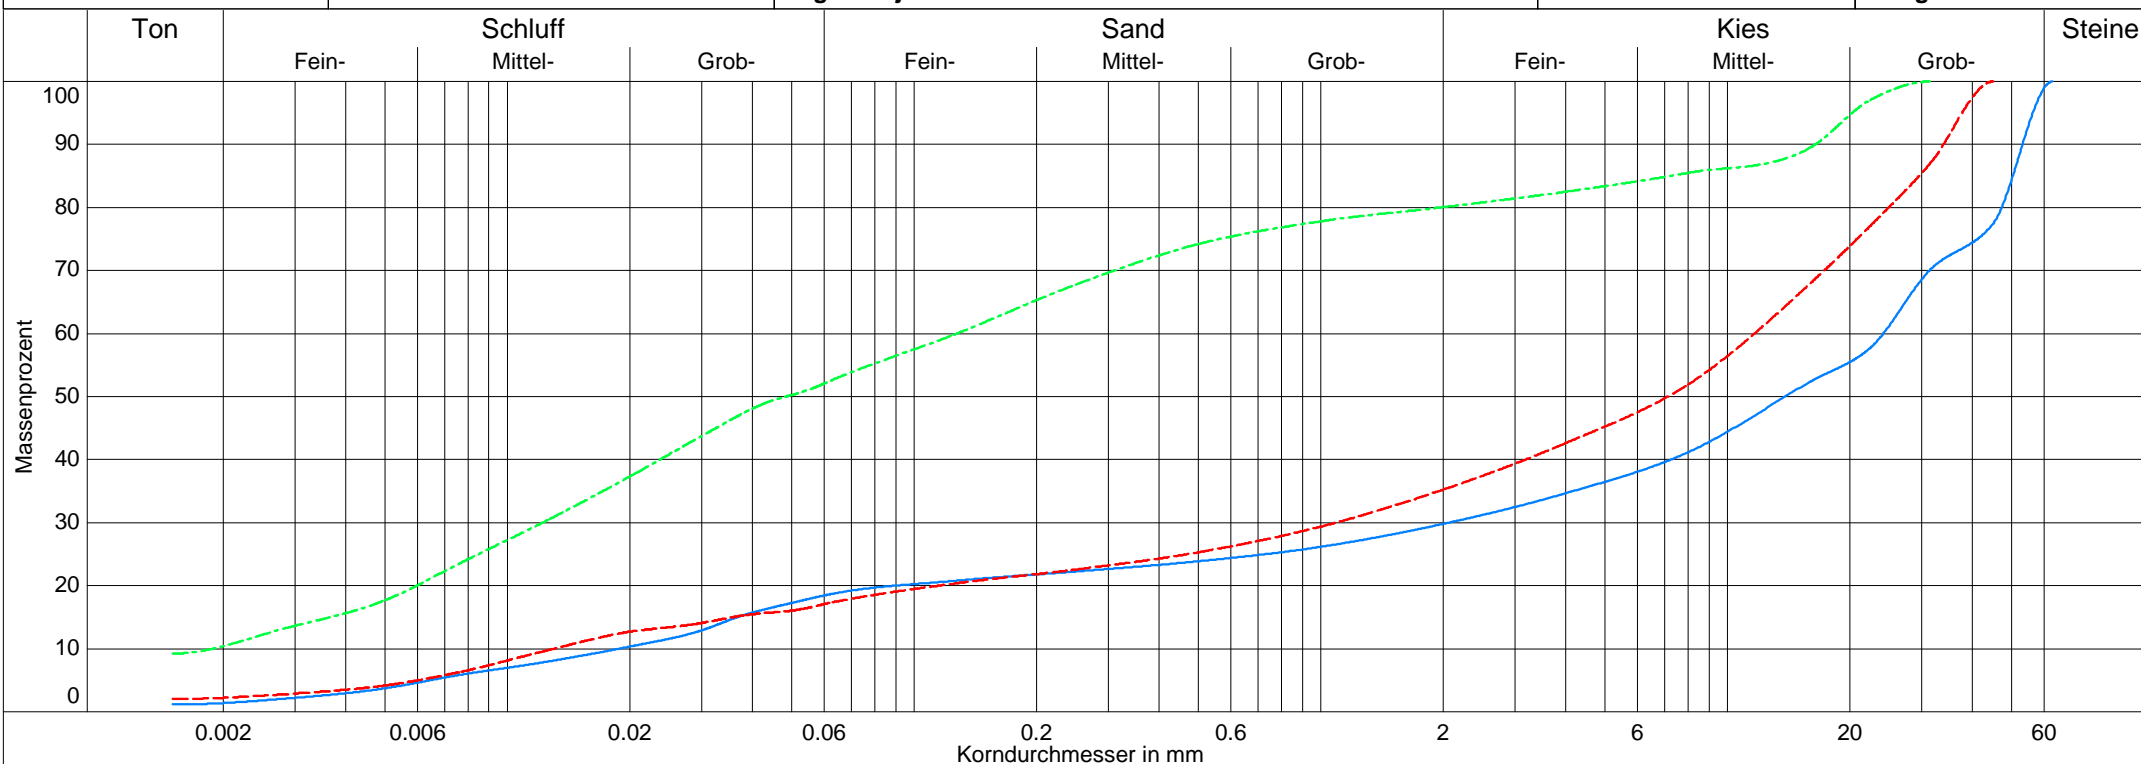

Labornummer	 KV 1 (154)	 KV 2 (155)	 KV 3 (156)		
Entnahmestelle	30/2	31/2	31/3		
Entnahmetiefe	0,20 - 1,00 m	0,40 - 2,85 m	2,85 - 5,10 m		
Ungleichförm. U	1285.5	895.4	67.6		
Krümmungszahl Cc	9.4	7.8	0.6		
Kornform	länglich, plattig	länglich, plattig	kubisch - plattig		
Oberfläche	glatt	glatt	rau , glatt		
Bodenansprache	Dammschüttung	Dammschüttung	Dammschüttung		
Wassergehalt	11.8 %	6.8 %	14.7 %		
Anteil < 0.063 mm	18.7 %	17.4 %	52.7 %		
d10 / d60	0.019/24.152 mm	0.013/11.644 mm	0.002/0.127 mm		
Frostempfindl.klasse	F3	F3	F3		